


TH-750V Steam Fired Single Unit Piping Hookup w/ Blend and Thermal Loop Diverter

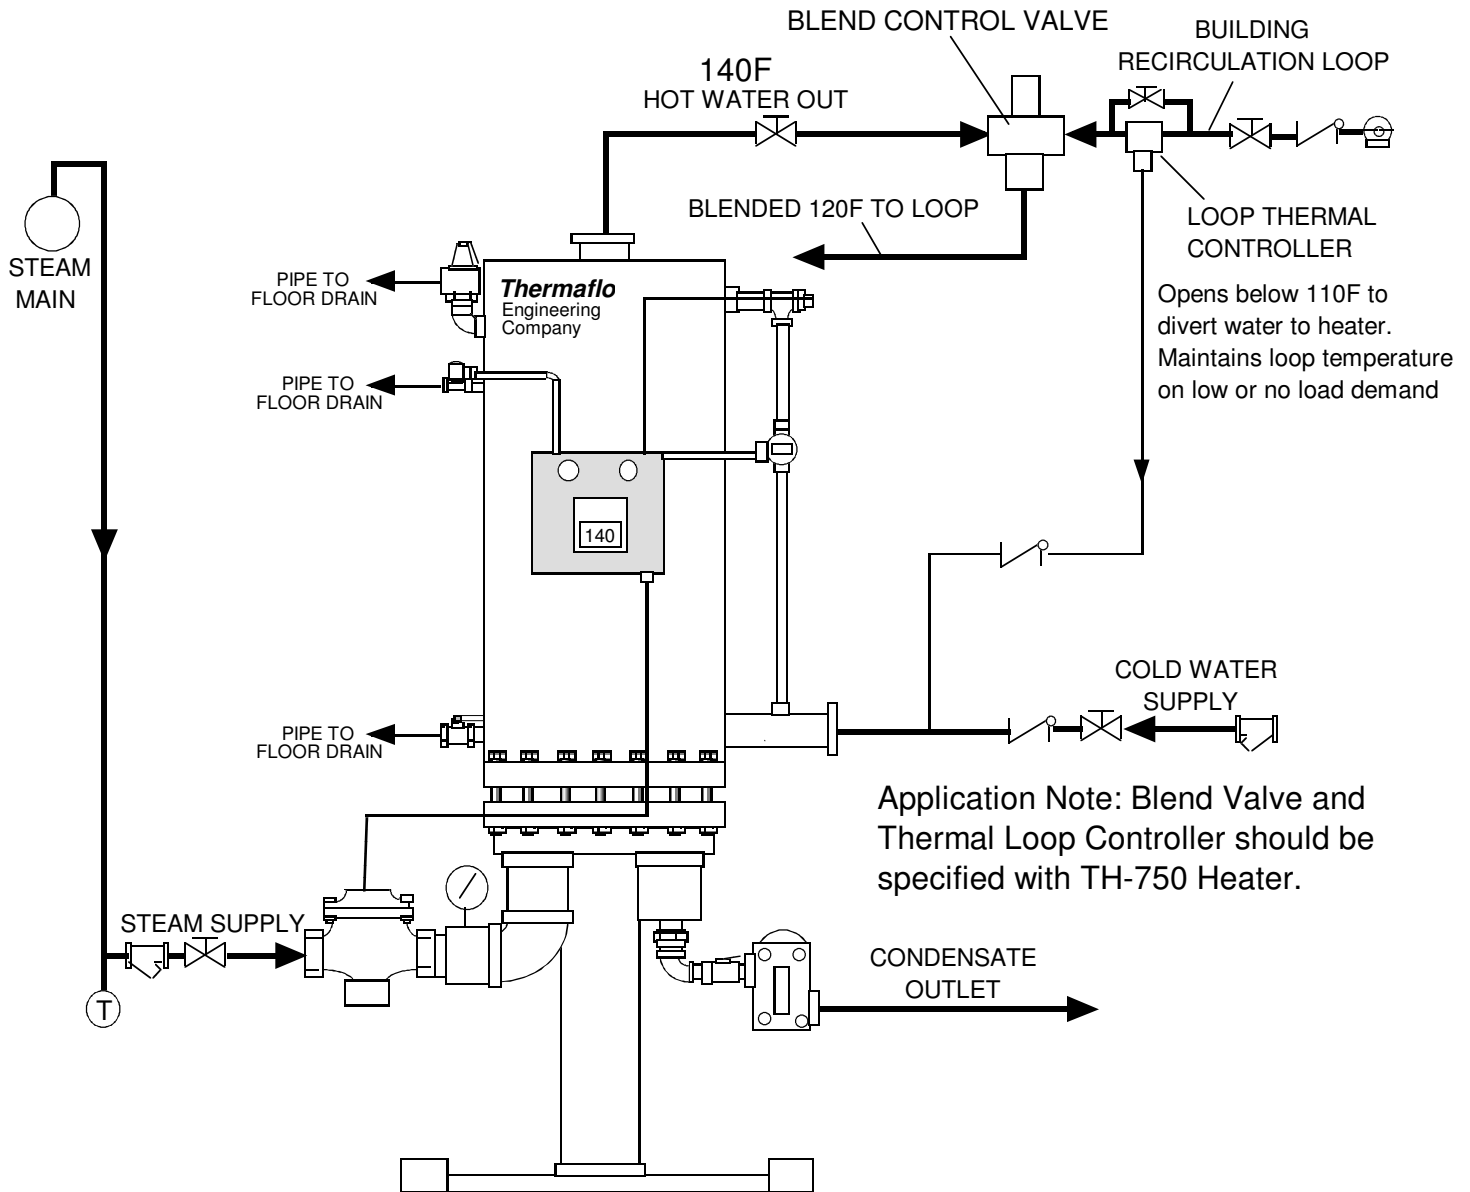

Notes:

1. SUGGESTED PIPING DESIGN. DESIGNER SHOULD CONSULT LOCAL CODES TO VERIFY COMPLIANCE.
2. ALWAYS PIPE OUTLET CONDENSATE TO GRAVITY ATMOSPHERIC RETURN LINES, TO AVOID WATERHAMMER AND INTERNAL STEAM SPACE FLOODING.
3. ALWAYS PIPE SUPPLY STEAM FROM THE TOP OF THE HEADER AS SHOWN, AND INSTALL A MAIN DRIP BEFORE CONTROL VALVE INLET.