


SUBMITTAL DATA

16" DIA. STEAM TO WATER U-TUBE HEAT EXCHANGER

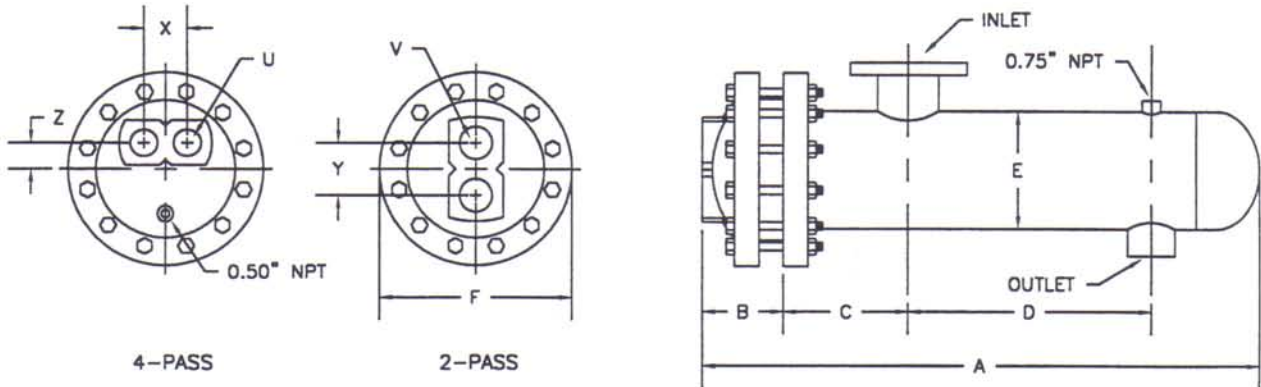

MODEL NO.	HEAT EXCHANGER								2 PASS			4 PASS												
	A	B	C	D	E	F	INLET	OUTLET	Y	V	SQ. FT.	X	Z	U	SQ. FT.									
S1636(*)A	52.87	5.75	11.00	24.00	16.00	23.50	6" FLG	2" NPT	9.00	6" NPT	115	8.00	4.00	4" NPT	111									
S1648(*)A	64.87			36.00							155				148									
S1660(*)A	76.87			48.00							194				186									
S1672(*)A	88.87			60.00			272	311			352				10" FLG	2.5" NPT	389	233	223					
S1684(*)A	100.87			72.00														261	298					
S1696(*)A	112.87			84.00														336	373					
S16108(*)A	124.87			96.00																				
S16120(*)A	136.87			108.00																				

(*) INSERT NUMBER OF PASSES.

MATERIALS OF CONSTRUCTION

PART	MATERIAL
HEAD	CAST IRON
SHELL	STEEL
TUBE SHEET	STEEL
TUBING	3/4" O.D. COPPER
BAFFLES	STEEL
CAGE MATERIAL	STEEL

DESIGNED & CONSTRUCTED PER ASME SECT VIII DIV 1

MAXIMUM OPERATING CONDITIONS

TUBE SIDE WORKING PRESSURE	125 PSI
SHELL SIDE WORKING PRESSURE	150 PSI
HYDROSTATIC TEST PRESSURE TUBE SIDE	250 PSI
HYDROSTATIC TEST PRESSURE SHELL SIDE	225 PSI
MAXIMUM TEMPERATURE TUBE SIDE	375°F
MAXIMUM TEMPERATURE SHELL SIDE	375°F

JOB NAME _____
 LOCATION _____
 ENGINEER _____
 CONTRACTOR _____
 SALES REP. _____

S16CL.DWG REV: A

MODEL NO. ORDERED

STEAM PRESSURE	
ENT TEMP.	LEAV TEMP
TUBE SIDE FLOW	LIQUID
FOULING FACTOR	SQ FT
TUBE SIDE PRESSURE DROP	FT
VELOCITY	FT/SEC