




	ISOLATION VALVE
	CHECK VALVE
	CIRCULATION PUMP
	STEAM TRAP
	STRAINER

## TH-750V Steam Fired Single Unit Piping Hookup

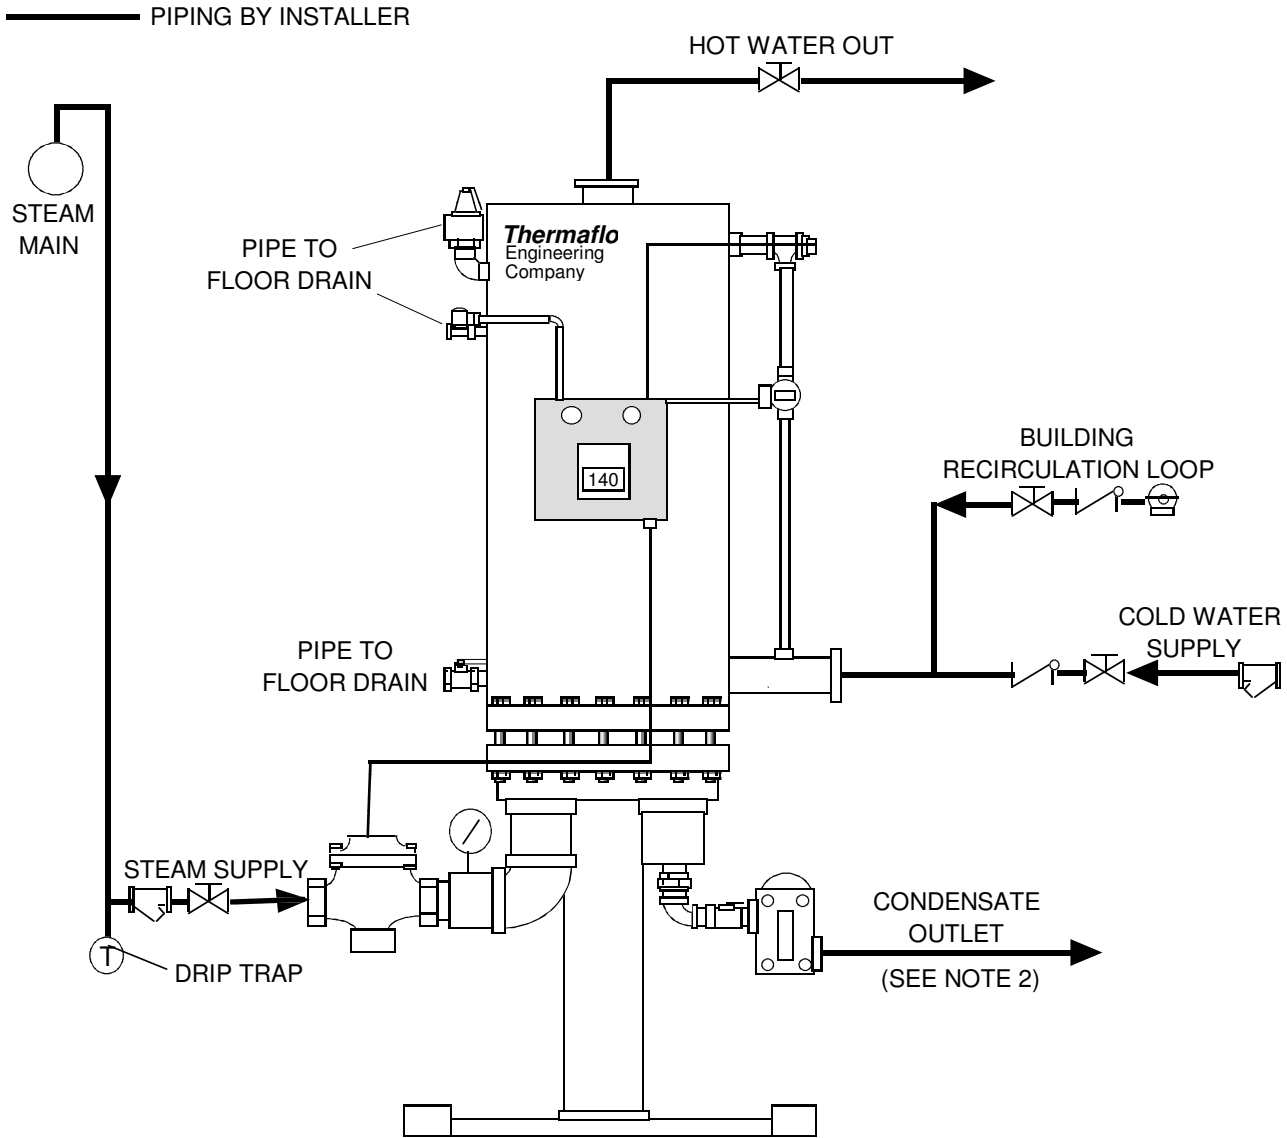

### Notes:

1. SUGGESTED PIPING DESIGN. DESIGNER SHOULD CONSULT LOCAL CODES TO VERIFY COMPLIANCE.
2. ALWAYS PIPE OUTLET CONDENSATE TO GRAVITY ATMOSPHERIC RETURN LINES, TO AVOID WATERHAMMER AND INTERNAL STEAM SPACE FLOODING.
3. ALWAYS PIPE SUPPLY STEAM FROM THE TOP OF THE HEADER AS SHOWN, AND INSTALL A MAIN DRIP BEFORE CONTROL VALVE INLET.
4. WHEN USING THE TH-750 FOR DOMESTIC LOOP SUPPLY IT IS HIGHLY RECOMMENDED TO INSTALL A THERMAFLO MASTER BLEND VALVE TO PREVENT ANY CHANCE OF SCALDING.
5. IF THE OUTLET WATER IS PIPED WITHOUT LOOP RECIRCULATION PLEASE CONSULT THE FACTORY FOR PROPER CONTROL VALVE AND CONTROLLER. OVERSHOOTING AND HIGH TEMP ALARMS WILL OCCUR.

